


NOTE:

1 — PLACEMENT OF STOP BOX CAN VARY FROM A MAXIMUM OF 5 FEET OUTSIDE THE PROPERTY LINE TO THE PROPERTY LINE. PLACEMENT OF THE STOP BOX OUTSIDE THE PROPERTY LINE IS PREFERRED.

2 — OWNER'S RESPONSIBILITY FOR LEAK REPAIR SHALL BE UP TO AND INCLUDING THE TUBE NUT WHICH THREADS ONTO THE STOP AND WASTE VALVE. OWNER'S RESPONSIBILITY FOR REPAIRS OTHER THAN LEAK REPAIR EXTENDS TO THE CORPORATION STOP.

3 — ACWWA WILL REPAIR LEAKS ON SERVICE LINES WHEN NOTIFIED, FROM THE CORPORATION STOP TO STOP AND WASTE VALVE.

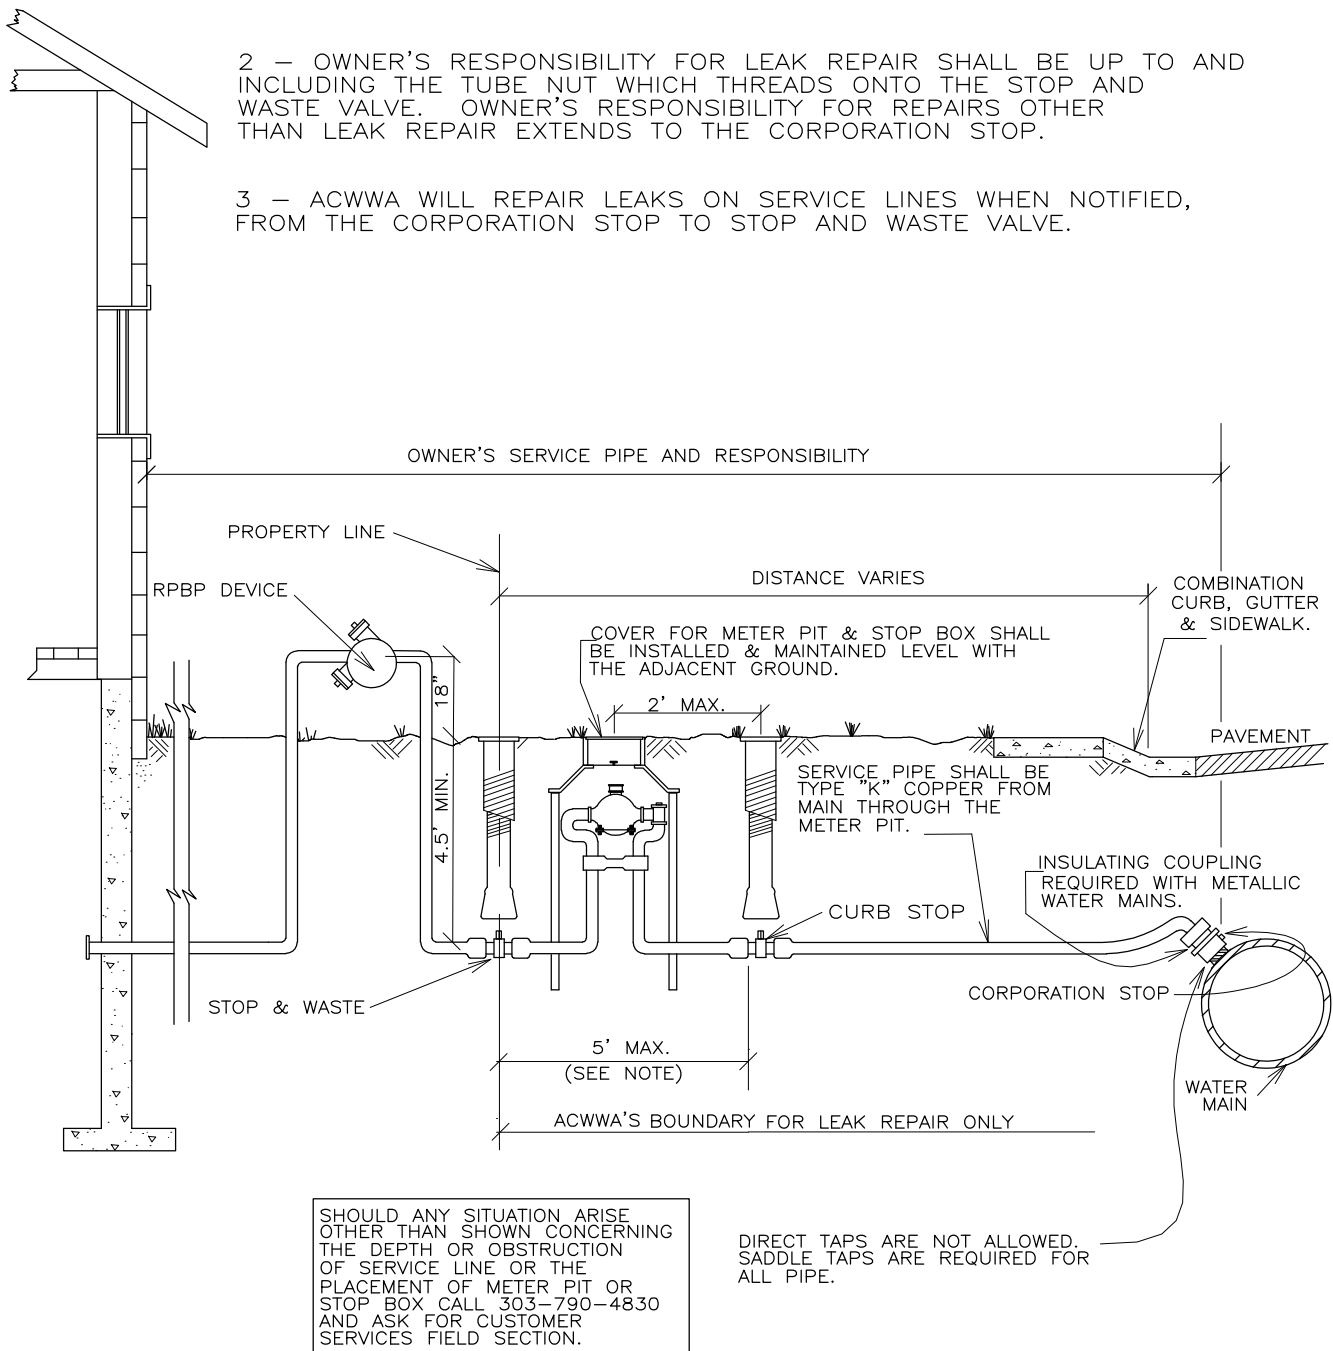

STANDARDS &
SPECIFICATIONS

REVISED:

**DOMESTIC METER
AND IRRIGATION
WITH RPBP**

DATE:

DRAWING NO. 200-28